


POINTS OF LATCHING FOR FIRE RATED DOORS

Points of Latching:


POINTS OF LATCHING	OPENING TYPE	DESCRIPTION
1 Point	Single Doors Only	Requires positive latching into frame
2 Point	Paired Openings	Rim Exit Device Both requires leaves latching into a mullion
3 Point*	Paired Openings	Active Leaf requires lock Inactive Leaf requires strike and top and bottom flush bolts
2 Point	Paired Openings	SVR-LBR/CVR-LBR/CVC-LBL require latching into top of frame
4 Point	Paired Openings	SVR/CVR/CVC require top and bottom latching on both leaves

- Reference [Fire Door Capability Chart](#) for specific hardware approval
- These hardware applications cannot be mixed, fire approvals for above options only
- *3-Point latching must latch, lock-to-strike door-to-door with top and bottom flush bolts
- Mortise Exit Devices are available for 3-Point* latching
- Multi-point locks have same requirements as CVR/CVC hardware
- Fire pins/Auxiliary latch do not count as a point of latching, top and bottom flush bolts required for 3-point latching

Single Doors

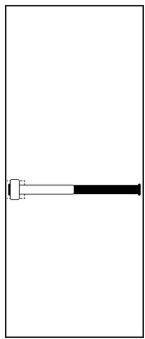


Single Mortise
Exit Device

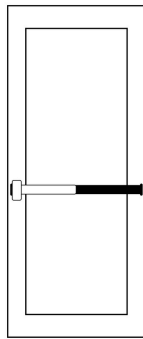

Single Rim
Exit Device




Single Mortise Lock

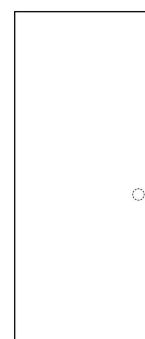


Single Cylindrical
Lock


Pairs of Doors

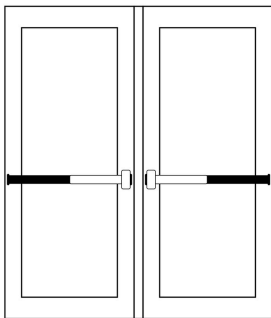


2-Point
Rim Exit Device into
Frame Mullion

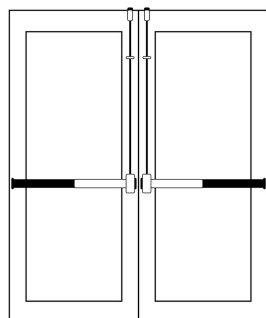


2-Point
SVR-LBR/CVR-
LBR/CVC-LBL
Standard Egress

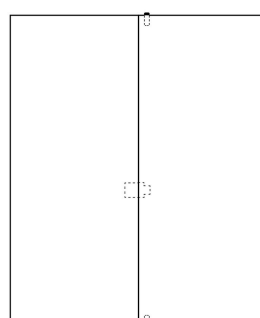

3-Point
Active-Lock / Inactive-Strike
Top and Bottom Flush Bolts
Standard Egress

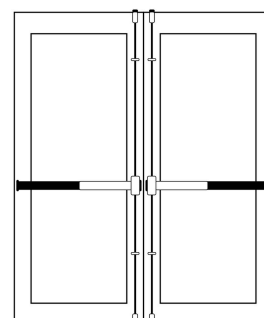

4-Point
SVR/CVR/CVC
Standard Egress

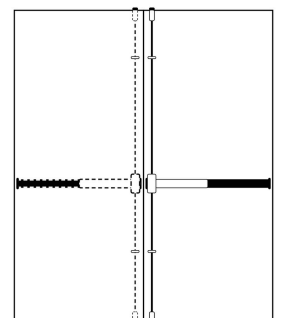

4-Point
SVR/CVR/CVC
Double Egress